


# Transformer Placement

New pathway for primary placed by TDI. Conductor by Oncor

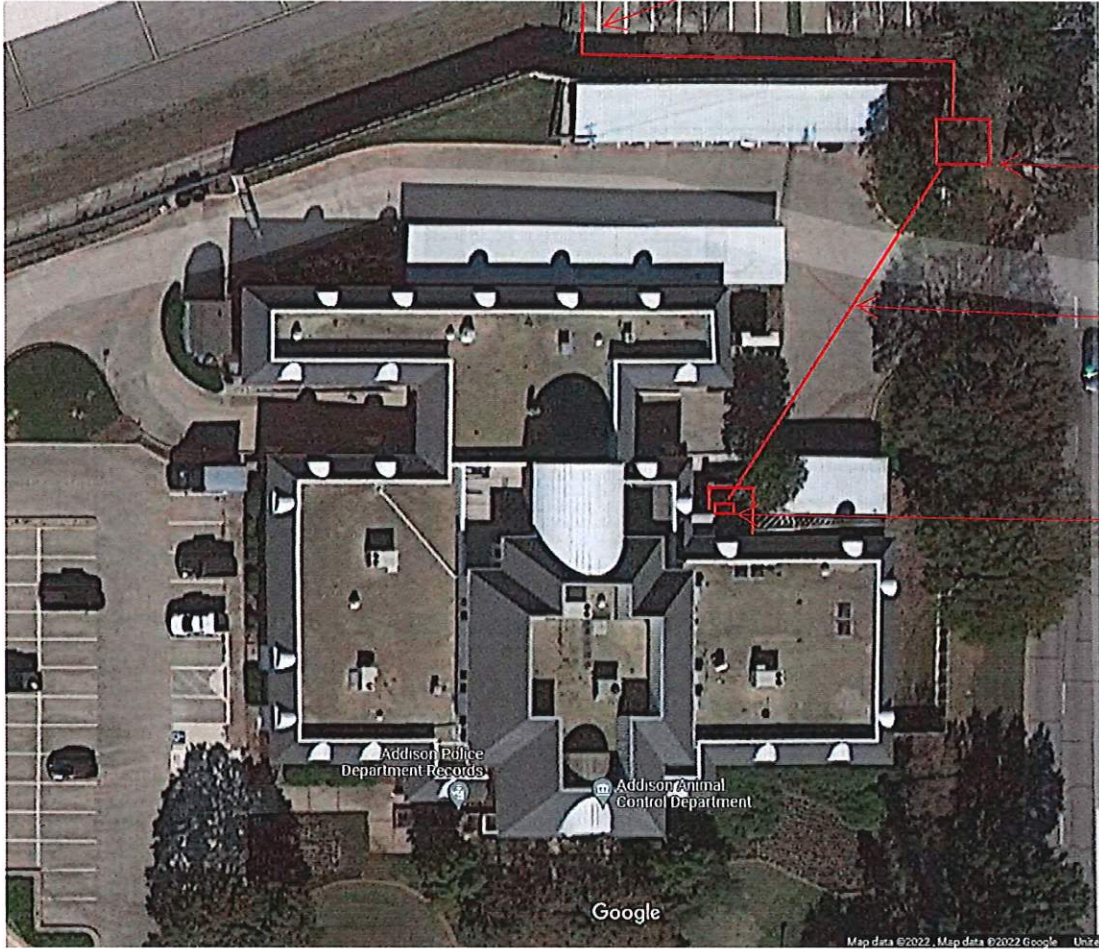

New Transformer placement

New secondary conduit and conductors by TDI.

Remove old transformer. Place wire pull box here.